



LOCAL GOVERNMENT ENERGY AUDIT PROGRAM: ENERGY AUDIT REPORT

PREPARED FOR:

**WATCHUNG BOARD OF
EDUCATION
ONE DR. PARENTY WAY
WATCHUNG, NJ 07069
ATTN: IRFAN EVCIL,
BUSINESS ADMINISTRATOR/BOARD
SECRETARY**

PREPARED BY:

CONCORD ENGINEERING GROUP



**520 S. BURNT MILL ROAD
VOORHEES, NJ 08043
TELEPHONE: (856) 427-0200
FACSIMILE: (856) 427-6529
WWW.CONCORD-ENGINEERING.COM**

CEG CONTACT:

**SAM DORIA
SENIOR ENERGY ENGINEER
EMAIL: SDORIA@CONCORD-ENGINEERING.COM**

REPORT ISSUANCE:

FINAL FEBRUARY 17, 2016

PROJECT NO:

1C15683

TABLE OF CONTENTS

I. EXECUTIVE SUMMARY 3

II. INTRODUCTION 7

III. METHOD OF ANALYSIS..... 9

IV. HISTORIC ENERGY CONSUMPTION/COST..... 11

 A. ENERGY USAGE11

 B. ENERGY USE INDEX (EUI).....13

 C. EPA ENERGY BENCHMARKING SYSTEM.....15

V. RENEWABLE/DISTRIBUTED ENERGY MEASURES 17

VI. ENERGY PURCHASING AND PROCUREMENT STRATEGY 19

VII. INSTALLATION FUNDING OPTIONS..... 31

 A. INCENTIVE PROGRAMS:.....31

 B. FINANCING OPTIONS:.....35

VIII. ENERGY AUDIT ASSUMPTIONS 38

Enclosures:

Document 1 – Valley View School Energy Report

Document 2 – Bayberry School Energy Report

REPORT DISCLAIMER

The information contained within this report, including any attachment(s), is intended solely for use by the named addressee(s). If you are not the intended recipient, or a person designated as responsible for delivering such messages to the intended recipient, you are not authorized to disclose, copy, distribute or retain this report, in whole or in part, without written authorization from Concord Engineering Group, Inc., 520 S. Burnt Mill Road, Voorhees, NJ 08043.

This report may contain proprietary, confidential or privileged information. If you have received this report in error, please notify the sender immediately. Thank you for your anticipated cooperation.

I. EXECUTIVE SUMMARY

This report presents the findings of the energy audit conducted for:

Entity: Watchung Board of Education

Facilities: Valley View School
Bayberry School

Contact Person: Irfan Evcil, Business Administrator/Board Secretary

This audit is performed in connection with the New Jersey Clean Energy - Local Government Energy Audit Program for the Watchung Board of Education. The purpose of this analysis is to provide the owner insight into the energy savings potential that exists within the facilities. Energy Efficiency changes and upgrades require support from the building occupants, operations personnel, and the administrators of the building in order to maximize the savings and overall benefit. The efficiency improvement of public buildings provides a benefit for the environment and the residents of New Jersey.

The Energy Conservation Measures (ECMs) identified within the reports represent the potential annual savings at each facility. It is recommended the owner consider all ECMs as part of an initiative to save energy, reduce emissions, and lower operating costs. The owner should review and be familiar with all measures presented in the reports prior to making a decision on which projects to move forward with.

Overall Assessment:

The School District is 23% more efficient than the PEER Comparison at the Valley View School and 24% more efficient than the PEER Comparison at the Bayberry School. The District's overall cost per square-foot for energy is \$1.32 which is well below the standard typical costs of \$2.00 per square-foot for K-12 school facilities. While this is not a definitive metric of energy inefficiency, it does provide guidance on facilities that are more energy cost intensive and likely have energy efficiency opportunities. The report outlines many recommendations across the facilities audited, that in totality could result in an energy cost reduction of nearly 24%.

On the whole, Concord Engineering recommends that the School District review and be familiar with all measures presented in each facility report prior to making a decision on which projects to move forward with. This will enable the District to effectively align report recommendations with those outlined in their mid/long range facility plans and financial plans. The District should also review all conventional and unconventional funding options, along with all NJCEP funding opportunities for these projects and determine which options fit their budget most positively in the short and long term. The combination of this information will enable the District to put together an effective Energy Savings Improvement Strategy that maximizes the received benefits of the selected projects. The Installation and Funding Options Section further outlines what programs are potentially available to the District for funding the project.

Concord has outlined below a combined project summary summing up all of the proposed projects for the audited facilities for consideration.

**Table 1
Combined Energy Conservation Project Summary**

COMBINED POTENTIAL ENERGY EFFICIENCY PROJECT					
FACILITY ENERGY EFFICIENCY PROJECTS	ANNUAL ENERGY SAVINGS (\$)	PROJECT COST (\$)	SMART START INCENTIVES	CUSTOMER COST	SIMPLE PAYBACK
Valley View School	\$31,314	\$518,847	\$46,170	\$472,677	15.1
Bayberry School	\$23,763	\$588,632	\$61,045	\$527,587	22.2
Total Entity Project	\$55,077	\$1,107,479	\$107,215	\$1,000,264	18.2

Total Entity Energy Costs: \$226,076
Est. Total Entity Energy Savings: \$55,077
Overall Percent Cost Reduction: 24.4%

Other Considerations:*Renewable Energy Conservation Measures:*

Renewable Energy Measures (REMs) were also reviewed for implementation at the Valley View School but were found to be uneconomical. The Bayberry School has two (2) solar arrays at the facility. Further details regarding the District's solar potential are outlined in the Renewable Energy section and each facility report.

The potential for wind generation was also reviewed for the District; however based on historical wind speed data, make it not a viable option.

Energy Procurement Recommendations:

The School District is currently contracted with a third party supplier for electric and natural gas, Concord Engineering recommends they continue to purchase their electric and natural gas commodity through a third party supplier once the current contract has expired. Furthermore when entering into a new contract it is important the District aggregates all of their facilities into one contract for electric and gas supply in order to maximize commodity price savings.

Maintenance and Operational Recommendations:

In addition to the ECMs and REMs, there are maintenance and operational measures that can provide significant energy savings and provide immediate benefit, many of which the School District is already performing. The ECMs listed above represent investments that can be made to the facility which are justified by the savings seen over time. However, the maintenance items and small operational improvements below are typically achievable with on-site staff or maintenance contractors and in turn have the potential to provide substantial operational savings compared to the costs associated. The following are recommendations which should be considered a priority in achieving energy efficient buildings since they are low cost/no cost energy conservation measures that include good operation & maintenance practices. Further recommendations per building are provided in the individual building reports:

1. Chemically clean the condenser and evaporator coils periodically to optimize efficiency. Poorly maintained heat transfer surfaces can reduce efficiency 5-10%.
2. Maintain all weather stripping on windows and doors.
3. Clean all light fixtures to maximize light output.
4. Provide more frequent air filter changes to decrease overall system power usage and maintain better IAQ.
5. Verify all control systems are utilizing setback and scheduling capabilities.
6. Replacement of older CRT style monitors with newer LCD/LED style monitors. Older CRT style monitors use up to four times more energy than LCD/LED monitor types.
7. The School District should consider the installation of advanced power strips in offices that can be used for computer components and additional appliances in order to reduce the amount of idle power draw from these devices. (Smart Power Strips Model LPG3, Price ~\$30)

II. INTRODUCTION

The comprehensive energy audit covers the following buildings in the Watchung Borough Board of Education:

ENERGY AUDIT FACILITY SUMMARY		
FACILITY	AREA (SQ-FT)	ADDRESS
Valley View School	81,061	50 Valley View Road, Watchung, NJ 07069
Bayberry School	90,704	113 Bayberry Lane, Watchung, NJ 07069

This audit is performed in connection with the New Jersey Clean Energy - Local Government Energy Audit Program. The energy audit is conducted to promote the mission of the office of Clean Energy, which is to use innovation and technology to solve energy and environmental problems in a way that improves the State's economy. This can be achieved through the wiser and more efficient use of energy.

Electrical and natural gas utility information is collected and analyzed for one full year's energy use of each building. The utility information allows for analysis of the building's operational characteristics; calculate energy benchmarks for comparison to industry averages, estimated savings potential, and baseline usage/cost to monitor the effectiveness of implemented measures. A computer spreadsheet is used to calculate benchmarks and to graph utility information (see the utility profiles below).

The Energy Use Index (EUI) is established for the building. Energy Use Index (EUI) is expressed in British Thermal Units/square foot/year (BTU/ft²/yr.), which is used to compare energy consumption to similar building types or to track consumption from year to year in the same building. The EUI is calculated by converting the annual consumption of all energy sources to BTU's and dividing by the area (gross square footage) of the building. Architectural drawings (where available) are utilized to verify the gross area of the facility. The EUI is a good indicator of the relative potential for energy savings. A low EUI indicates less potential for energy savings, while a high EUI indicates poor building performance therefore a high potential for energy savings.

Existing building architectural and engineering drawings (where available) are utilized for additional background information. The building envelope, lighting systems, HVAC equipment, and controls information gathered from building drawings allow for a more accurate and detailed review of the building. The information is compared to the energy usage profiles developed from utility data. Through the review of the architectural and engineering drawings a building profile can be defined that documents building age, type, usage, major energy consuming equipment or systems, etc.

The preliminary audit information is gathered in preparation for the site survey. The site survey provides critical information in deciphering where energy is spent and opportunities exist within a facility. The entire site is surveyed to inventory the following to gain an understanding of how each facility operates:

- Building envelope (roof, windows, etc.)
- Heating, ventilation, and air conditioning equipment (HVAC)
- Lighting systems and controls
- Facility-specific equipment

The building site visit is performed to survey all major building components and systems. The site visit includes detailed inspection of energy consuming components. Summary of building occupancy schedules, operating and maintenance practices, and energy management programs provided by the building manager are collected along with the system and components to determine a more accurate impact on energy consumption.

III. METHOD OF ANALYSIS

This audit is consistent with an ASHRAE Level 2 energy audit. The cost and savings for each measure is $\pm 20\%$. The evaluations are based on engineering estimations and industry standard calculation methods. More detailed analyses would require engineering simulation models, hard equipment specifications, and contractor bid pricing.

Post site visit work includes evaluation of the information gathered, researching possible conservation opportunities, organizing the audit into a comprehensive report, and making recommendations on HVAC, lighting and building envelope improvements. Data collected is processed using energy engineering calculations to anticipate energy usage for each of the proposed energy conservation measures (ECMs). The actual building's energy usage is entered directly from the utility bills provided by the owner. The anticipated energy usage is compared to the historical data to determine energy savings for the proposed ECMs.

It is pertinent to note, that the savings noted in this report are not additive. The savings for each recommendation is calculated as standalone energy conservation measures. Implementation of more than one ECM may in some cases affect the savings of each ECM. The savings may in some cases be relatively higher if an individual ECM is implemented in lieu of multiple recommended ECMs. For example implementing reduced operating schedules for inefficient lighting will result in a greater relative savings. Implementing reduced operating schedules for newly installed efficient lighting will result in a lower relative savings, because there is less energy to be saved.

The project / entity summary tables are based on the implementation of multiple measures. The analysis is reviewed and determined if the nature of the ECMs will cause a major conflict of the overall savings. When additive measures do not cause a major effect on the overall savings the ECMs are included. Where a major conflict is identified, the combined savings is evaluated appropriately to ensure the overall estimates are $\pm 20\%$. ECMs are determined by identifying the building's unique properties and deciphering the most beneficial energy saving measures available that meet the specific needs of the facility. The building construction type, function, operational schedule, existing conditions, and foreseen future plans are critical in the evaluation and final recommendations. Energy savings are calculated based on industry standard methods and engineering estimations. Energy consumption is calculated based on manufacturer's cataloged information when new equipment is proposed.

Cost savings are calculated based on the actual historical energy costs for the facility. Installation costs include labor and equipment costs to estimate the full up-front investment required to implement a change. Costs are derived from Means Cost Data, industry publications, and local contractors and equipment suppliers. The NJ Smart Start Building® program incentives savings (where applicable) are included for the appropriate ECM's and subtracted from the installed cost. Maintenance savings are calculated where applicable and added to the energy savings for each ECM. The life-time for each ECM is estimated based on the typical life of the equipment being replaced or altered. The costs and savings are applied and a simple payback, simple lifetime savings, and simple return on investment are calculated. See below for calculation methods:

ECM Calculation Equations:

$$\text{Simple Payback} = \left(\frac{\text{Net Cost}}{\text{Yearly Savings}} \right)$$

$$\text{Simple Lifetime Savings} = (\text{Yearly Savings} \times \text{ECM Lifetime})$$

$$\text{Simple Lifetime Return on Investment (ROI)} = \frac{(\text{Simple Lifetime Savings} - \text{Net Cost})}{\text{Net Cost}}$$

$$\text{Lifetime Maintenance Savings} = (\text{Yearly Maintenance Savings} \times \text{ECM Lifetime})$$

$$\text{Net Present Value} = \sum_{n=0}^N \left(\frac{\text{Cash Flow of Period}_n}{(1 + \text{DR})^n} \right)$$

$$\text{Internal Rate of Return (IRR)} \rightarrow \text{Net Present Value} = 0 = \sum_{n=0}^N \left(\frac{\text{Cash Flow of Period}_n}{(1 + \text{IRR})^n} \right)$$

Net Present Value calculations are based on Discount Rate (DR) of 3%.

IV. HISTORIC ENERGY CONSUMPTION/COST

A. Energy Usage

The energy usage for the facilities is tabulated and plotted in graph form as depicted within each facility report (see the individual facility energy audit reports for details). Each energy source has been identified and monthly consumption and cost noted per the information provided by the District. The electric and natural gas utilities are shown below in Table 2 & 3 for both facilities:

**Table 2
Electric Utility Summary**

ELECTRIC UTILITY USAGE PER FACILITY			
FACILITY	ANNUAL ELECTRIC UTILITY		
DESCRIPTION	USAGE (KWH)	COST (\$)	AVE RATE (\$/KWH)
Valley View School	555,698	\$96,351	\$0.173
Bayberry School	590,173	\$79,615	\$0.135
Total	1,145,871	\$175,966	\$0.154

**Table 3
Natural Gas Summary**

NATURAL GAS UTILITY USAGE PER FACILITY			
FACILITY	ANNUAL NATURAL GAS UTILITY		
DESCRIPTION	USAGE (THERMS)	COST (\$)	AVE RATE (\$/THERM)
Valley View School	27,015.3	\$22,813	\$0.84
Bayberry School	32,463.4	\$27,296	\$0.84
Total	59,479	\$50,110	\$0.84

B. Energy Use Index (EUI)

Energy Use Index (EUI) is a measure of a building's annual energy utilization per square foot of building. This calculation is completed by converting all utility usage consumed by a building for one year, to British Thermal Units (BTU) and dividing this number by the building square footage. EUI is a good measure of a building's energy use and is utilized regularly for comparison of energy performance for similar building types. The Oak Ridge National Laboratory (ORNL) Buildings Technology Center under a contract with the U.S. Department of Energy maintains a Benchmarking Building Energy Performance Program. The ORNL website determines how a building's energy use compares with similar facilities throughout the U.S. and in a specific region or state.

Source use differs from site usage when comparing a building's energy consumption with the national average. Site energy use is the energy consumed by the building at the building site only. Source energy use includes the site energy use as well as all of the losses to create and distribute the energy to the building. Source energy represents the total amount of raw fuel that is required to operate the building. It incorporates all transmission, delivery, and production losses, which allows for a complete assessment of energy efficiency in a building. The type of utility purchased has a substantial impact on the source energy use of a building. The EPA has determined that source energy is the most comparable unit for evaluation purposes and overall global impact. Both the site and source EUI ratings for the building are provided to understand and compare the differences in energy use.

The Energy Cost Index (ECI) can be used as another metric to assist in benchmarking a building's energy performance. In instances where entities own multiply buildings the ECI can allow them to quickly compare energy costs between buildings based on a common unit. Facility's with high costs per square-foot can alert the owner to the potential for energy efficiency improvements and/or warrant further investigation to determine why the costs are higher.

The site and source EUI, and ECI for each facility is calculated as follows:

$$\text{Building Site EUI} = \frac{(\text{Electric Usage in kBtu} + \text{Fuel Usage in kBtu})}{\text{Building Square Footage}}$$

$$\text{Building Source EUI} = \frac{(\text{Electric Usage in kBtu} \times \text{SS Ratio} + \text{Fuel Usage in kBtu} \times \text{SS Ratio})}{\text{Building Square Footage}}$$

$$\text{Building ECI} = \frac{(\text{Electric Cost} + \text{Natural Gas Cost} + \text{Fuel Oil Cost} + \text{Propane Cost})}{\text{Building Square Footage}}$$

**Table 6
Energy Use Index Summary**

ENERGY USE INDEX PER FACILITY				
FACILITY	BUILDING AREA	ENERGY USE INDEX		ENERGY COST INDEX
DESCRIPTION	(SF)	SITE (KBTU/SF/YR)	SOURCE (KBTU/SF/YR)	\$/SF/YR
Valley View School	81,061	56.7	108.5	\$1.47
Bayberry School	90,704	58.0	107.3	\$1.18
Total	171,765	57.4	107.9	\$1.32

Note: A further comparison of Site and Source EUI to Peer Group Comparison building data published by the Energy and Information Administration is provided in each individual building report. It should be cautioned that not all buildings perfectly match a Peer Group Comparison Type.

C. EPA Energy Benchmarking System

The United States Environmental Protection Agency (EPA) in an effort to promote energy management has created a system for benchmarking energy use amongst various end users. The benchmarking tool utilized for this analysis is entitled Portfolio Manager. The Portfolio Manager tool allows tracking and assessment of energy consumption via the template forms located on the ENERGY STAR website (www.energystar.gov). The importance of benchmarking for local government municipalities is becoming more important as utility costs continue to increase and emphasis is being placed on carbon reduction, greenhouse gas emissions and other environmental impacts.

Based on information gathered from the ENERGY STAR website, Government agencies spend more than \$10 billion a year on energy to provide public services and meet constituent needs. Furthermore, energy use in commercial buildings and industrial facilities is responsible for more than 50 percent of U.S. carbon dioxide emissions. It is vital that local government municipalities assess facility energy usage, benchmark energy usage utilizing Portfolio Manager, set priorities and goals to lessen energy usage and move forward with priorities and goals.

In accordance with the Local Government Energy Audit Program, CEG has created an ENERGY STAR account for the owner to access and monitoring the facility's yearly energy usage as it compares to facilities of similar type. The login page for the account can be accessed at the following web address; the username and password are also listed below:

<https://www.energystar.gov/istar/pmpam/index.cfm?fuseaction=login.login>

User Name: WatchungBOE
Password: Lgeaceg2016

Security Question #1: What city were you born in?
Security Answer #1: Watchung

Security Question #2: In what city does your nearest sibling live?
Security Answer #2: Watchung

Note: It is recommended the School District change the account password once the audit process is complete.

The utility bills and other information gathered during the energy audit process are entered into the Portfolio Manager. The following is a summary of the results for both facilities:

**Table 5
Energy Star Performance Summary**

ENERGY STAR PERFORMANCE RATING PER FACILITY			
FACILITY	ENERGY STAR PERFORMANCE RATING		
DESCRIPTION	SCORE	AVERAGE	POTENTIAL CERTIFICATIONS
Valley View School	68	50	No
Bayberry School	87	50	Yes

See the Appendix C - Statement of Energy Performance for comparative facilities
 Score: "N/A" represents facility that could not receive a rating. See Energy Star website for details.

Refer to **Statement of Energy Performance Appendix** for the detailed energy summary for each facility.

V. RENEWABLE/DISTRIBUTED ENERGY MEASURES

Globally, renewable energy has become a priority affecting international and domestic energy policy. The State of New Jersey has taken a proactive approach, and has recently adopted in its Energy Master Plan a goal of 30% renewable energy by 2020. To help reach this goal New Jersey created the Office of Clean Energy under the direction of the Board of Public Utilities and instituted a Renewable Energy Incentive Program to provide additional funding to private and public entities for installing qualified renewable technologies. A renewable energy source can greatly reduce a building's operating expenses while producing clean environmentally friendly energy.

Solar Generation


The Watchung Board of Education investigated installing PV arrays at the Valley View School. It was discovered by the Structural Engineer that the existing roof (including the 2003 expansion) did not have enough residual capacity to safely support the additional weight of any PV array. The west side of the property at the parking lot was also considered for a carport PV system but the parking lot is shaded throughout a substantial portion of the day. Finally, a PV canopy over the courtyard at the roof elevation was deemed cost prohibitive due to the cost of the structural supports required and did not produce a satisfactory ROI.

In 2013, a PV system was installed by Somerset County on the center section of the roof (73 kW) and a canopy over one parking lot (112 kW) at the Bayberry School.

Wind Generation

In addition to evaluating solar, Concord also conducted a review of the applicability of wind energy for the County. Wind energy production is another option available through the Renewable Energy Incentive Program. Wind turbines of various types can be utilized to produce clean energy on a per building basis. Cash incentives are available per kWh of electric usage. Concord investigated the potential for smaller building mountable wind turbines, and horizontal turbines to maximize the available free space. In order to be economically viable a site requires a minimum average wind speed of 6 meters per second (13.5 mph). Based on the obtained wind data shown in **Figure 3** for Watchung, NJ the annual average wind speed is 10.2 mph with a peak of 12.0 mph, making this area unattractive for wind development. Therefore, wind energy is not a viable option to implement.

**Figure 3: Monthly Wind Speed
(Watchung, New Jersey)**

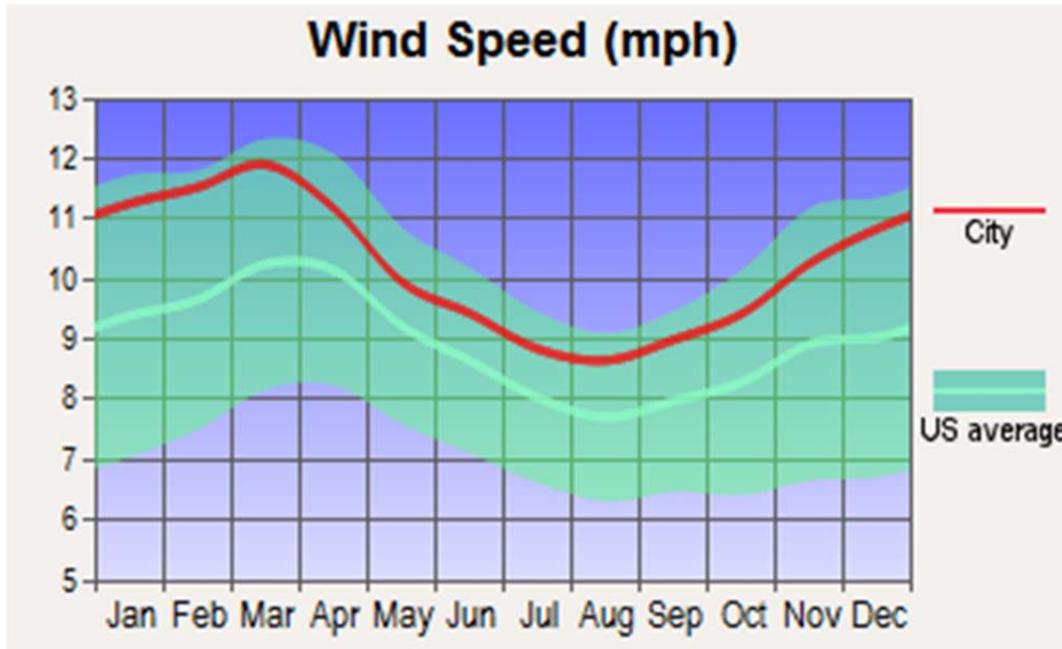

VI. ENERGY PURCHASING AND PROCUREMENT STRATEGY

Load Profile:

Load Profile analysis was performed to determine the seasonal energy usage of the facilities. Irregularities in the load profile will indicate potential problems within the facilities. Consequently based on the profile a recommendation will be made to remedy the irregularity in energy usage. For this report, the facilities energy consumption data was gathered in table format and plotted in graph form to create the load profile. Refer to The Electric and Natural Gas Usage Profiles included within this report to reference the respective electricity and natural gas usage load profiles.

Electricity:

The electricity usage profile demonstrates a summer cooling dominated load profile from winter to summer. As depicted in the table below the electric consumption increases during the summer months by 18%

ELECTRIC UTILITY SEASONAL LOAD PROFILE				
FACILITY	SEASONAL AVERAGES			
	WINTER (OCT - MAY)		SUMMER (JUN - SEP)	
DESCRIPTION	KWH PER MONTH	KW PER MONTH	KWH PER MONTH	KW PER MONTH
Valley View School	44,219	177.68	50,487	231.55
Bayberry School	49,358	178.96	48,827	188.68

The historical usage profile is less than favorable as typically winter commodity rates are lower due to reduced demand on the grid, compared with summer. Third Party Supplier (TPS) electric commodity contracts that offer a firm, fixed price for 100% of the facilities electric requirements and are lower than the BGS-FP default rate are recommended.

Natural Gas:

The Natural Gas Usage Profile demonstrates a heating load dominated profile, with significant consumption drop off during the summer months. The table below shows a steep drop off from winter to summer consumption.

NATURAL GAS UTILITY SEASONAL LOAD PROFILE		
FACILITY	SEASONAL AVERAGES	
	WINTER (OCT - MAY)	SUMMER (JUN - SEP)
DESCRIPTION	THERM PER MONTH	THERM PER MONTH
Valley View School	3,316	122
Bayberry School	4,039	37

This load profile will yield less than favorable natural gas prices due to the heating dominated profile. Higher winter month consumption will yield higher pricing which will not be offset by the summer month consumption. Nymex commodity pricing is generally higher in the winter months of November – March and lower in the summer months of April – October.

Tariff Analysis:

Electricity:

The facilities receive electrical service from Public Service Electric and Gas (PSE&G) under commercial rate classification Large Power and Lighting Service (LPLS). The facility has contracted a new Third Party Supplier (TPS) to provide electric commodity service. Direct Energy has been contracted; however the contract particulars such as product structure, price, term and conditions were not available for review or comments. For electric supply (generation) service, the client has a choice to either use PSE&G's default service rate BGS or contract with a Third Party Supplier (TPS) to supply electricity.

Each year since 2002, the four New Jersey Electric Distribution Companies (EDCs) - Public Service Electric & Gas Company (PSE&G), Atlantic City Electric Company (ACE), Jersey Central Power & Light Company (JCP&L), and Rockland Electric Company (RECO) - have procured several billion dollars of electric supply to serve their Basic Generation Service (BGS) customers through a statewide auction process held in February.

BGS refers to the service of customers who are not served by a third party supplier or competitive retailer. This service is sometimes known as Standard Offer Service, Default Service, or Provider of Last Resort Service.

The Auction Process has consisted of two auctions that are held concurrently, one for larger customers on an hourly price plan (BGS-CIEP) and one for smaller commercial and residential customers on a fixed-price plan (BGS-FP). This facility's rate structure is based on the fixed-price plan (BGS-FP).

The utility will continue to be responsible for maintaining the existing network of wires, pipes and poles that make up the delivery system, which will serve all consumers, regardless of whom they choose to purchase their electricity or natural gas from. PSE&G's delivery service rate includes the following charges: Customer Service Charge, Distribution Charge (kWh and Demand), Societal Benefits Charge (SBC), and Securitization Transition Charge.

Natural Gas:

The facilities currently receive natural gas distribution service from PSE&G under rate schedule Large Volume Gas (LVG). The facilities have recently contracted with a Third Party Supplier (TPS) Direct Energy; however the contract particulars such as product structure, price, term and conditions were not available for review or comments. For natural gas supply service, the client has a choice to either use the utility's default service rate BGSS or contract with a Third Party Supplier (TPS) to supply natural gas commodity service.

The utility provides basic gas supply service (BGSS) to customers who choose not to shop from a Third Party Supplier (TPS) for natural gas commodity. The option is essential to protect the reliability of service to consumers as well as protecting consumers if a third party supplier defaults or fails to provide commodity service.

The utilities are responsible for maintaining the existing network of wires, pipes and poles that make up the delivery system, which will serve all consumers, regardless of whom they choose to purchase their electricity or natural gas from the utility's delivery service rate includes the following charges: Customer Service Charge, Distribution Charge, & Societal Benefits Charge (SBC).

Electric and Natural Gas Commodities Market Overview:

In our region, electricity is produced by natural gas, nuclear, coal and renewables. Much of the recent electricity price fluctuations can be attributed to the spot natural gas pricing variations on generation that produces electricity and the retirement of coal plants that result in increased production demand from other sources of generation.

It is important to note that both natural gas and electric commodity market prices are moved by supply and demand, political conditions, market technicals and trader sentiment. The market is continuously changing Energy commodity pricing is also correlated to weather forecasts. Because weather forecasts are dependable only in the short-term, prolonged temperature extremes can really cause extreme price swings.

Short Term Energy Outlook - US Energy Information Administration (February 2015):


U.S. Natural Gas Prices. Natural gas spot prices averaged \$1.93/MMBtu at the Henry Hub in December, a decrease of \$0.016/MMBtu from November. The monthly average natural gas price

is expected rise through 2016, but will remain lower than \$3/MMBtu until December. Projected Henry Hub natural gas price averages \$2.65/MMBtu in 2016 and \$3.22/MMBtu in 2017.

Natural gas futures prices for December 2015 delivery (for the five-day period ending September 3, 2015) averaged \$2.91/MMBtu. Current options and futures prices imply that market participants place the lower and upper bounds for the 95% confidence interval for December 2015 contracts at around \$2.08/MMBtu and \$4.06/MMBtu, respectively.

Henry Hub Natural Gas Price

dollars per million Btu

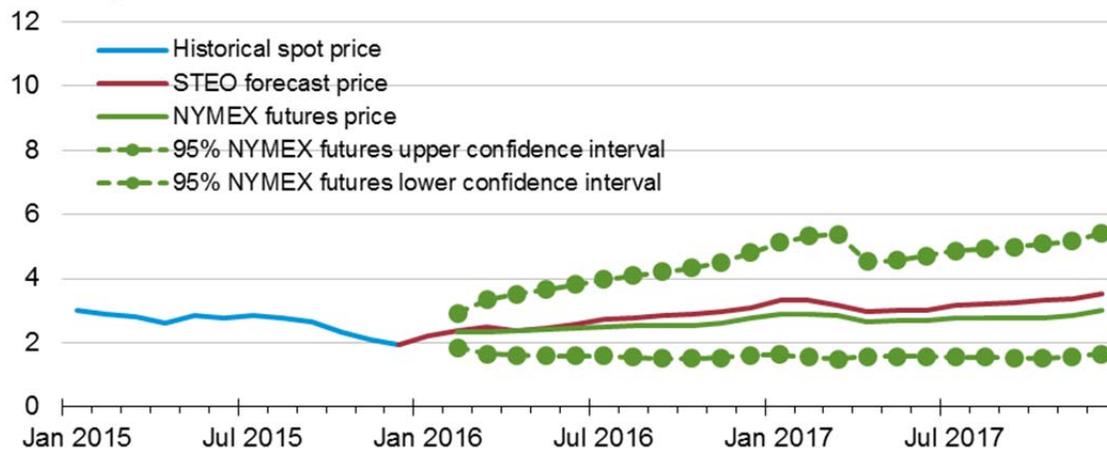


Note: Confidence interval derived from options market information for the 5 trading days ending Jan. 7, 2016. Intervals not calculated for months with sparse trading in near-the-money options contracts.

Source: Short-Term Energy Outlook, January 2016.

U.S. Electricity Retail Prices. EIA expects the U.S. residential price of electricity to average 12.7 cents per kilowatt-hour in 2016, which is unchanged from the average price last year. EIA has projected retail sales of electricity to the commercial sector to grow by 0.9% in 2016, and grow by 1.1% in 2017.


U.S. Residential Electricity Price

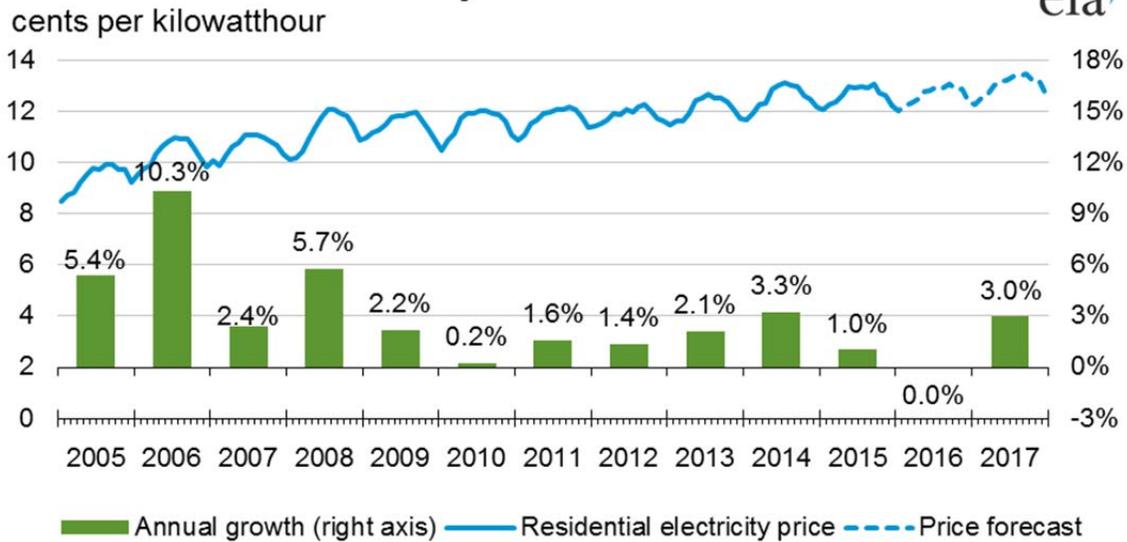

Source: Short-Term Energy Outlook, January 2016.

U.S. Petroleum Product Prices. EIA projected lower crude oil prices for this winter compared to less with a forecast reduction in heating oil expenditures. Compared to last winter retail heating oil prices are expected to average \$2.17/Gal this winter, 87 cents/gallon less than last year.

U.S. Diesel Fuel and Crude Oil Prices

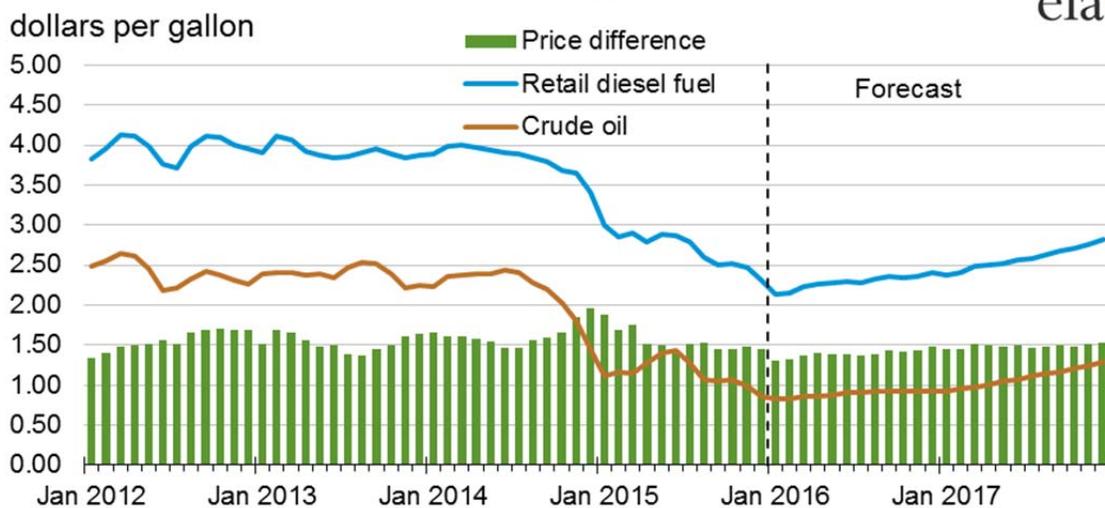

Crude oil price is composite refiner acquisition cost. Retail prices include state and federal taxes.

Source: Short-Term Energy Outlook, January 2016.

Contracting with Third Party Suppliers and BGS Bidding Options

Cooperative Purchasing:

Cooperative Purchasing agreements allow multiple parties to come together under the premise of using purchasing power in order to reduce the price for goods and services. In this instance the Cooperative is under the unified goal of reducing energy prices for its members. As such members of the cooperative pool their respective energy consumption together into a single bid to obtain low cost energy pricing.

Many Cooperatives have a formal bidding process and insure all suppliers provide the required documentation and paperwork necessary per New Jersey Administrative Code and Procurement Law. In addition, a Master Agreement is incorporated into the bid specifications with terms and conditions for the energy supply award protecting Local Government Entities. Concord does not recommend signing any Third Party Supplier contract or agreement unless it has been heavily vetted by an attorney that understands commodity law and regulation. Many government clients that have signed third party supplier contracts are now experiencing regulatory pass-thru charges due to vague or inadvertently agreed terms and conditions.

Important information can be found on DCA's website regarding Cooperative Purchasing.

Please visit web link:

http://www.state.nj.us/dca/divisions/dlgs/programs/lpcl_docs/Procuring_Power_Supply_through_a_Cooperative_Purchasing_System.pdf

It is important with any commodity procurement undertaking that you incorporate a rational, defensible strategy for purchasing commodity in volatile markets based upon the following:

- Budgets that reflect sound market intelligence
- An understanding of historical prices and trends
- Awareness of seasonal opportunities (e.g. shoulder months)
- Negotiation of fair contractual terms
- An aggressive, market based price

Bidding Practices and Processes:

Different bid processes and methodologies can create different objectives, but transparency is always a primary goal. Closed bid competitive purchase RFBs, online bid receipt or online reverse auctions can be utilized. Firms which can provide online bidding and reverse auctions are approved by the New Jersey Division of Local Government Services pursuant to the Local Unit Electronic Technology Program, (P.L.2001, c. 30). Approved firms can be found on the website at: <http://www.state.nj.us/dca/divisions/dlgs/programs/lpcl.html>. The Board of Public Utilities also offers a list of energy suppliers available for each service territory that can be found on the website at: <http://www.bpu.state.nj.us/bpu/commercial/shopping.html#nbr1>

Over the last decade, Concord has been involved with numerous approaches to bidding including the Traditional Sealed Bid format and Online Reverse Auction methods. In our experience, Online Reverse Auctions do not always produce optimum results for retail commodity purchases. The procurement consultant with the Client should determine a bidding practice that will yield optimum results and create a robust competitive environment. Many factors will come into consideration to determine whether the Online Bidding and/or Reverse Auction method is

appropriate. Factors such as annual consumption, number and complexity of accounts, potential supplier participation as well as rate tariffs must be taken into consideration.

LGE's Purchasing Options:

Per DCA's paper entitled "Taking Advantage of Lower Electric Rates for your Government Agency" they state, "First, it is important to emphasize that procurement of power supply *must* be consistent with the Local Public Contracts Law (LPCL) or for boards of education, the Public School Contracts Law (PSCL). Bottom line: When the estimated amount of spending for *power supply* is above the contracting unit's bid threshold, power supply must be publicly bid or purchased subject to an exception to the bid law. "Full text can be found via web link: http://www.state.nj.us/dca/divisions/dlgs/programs/lpcl_docs/Taking_Advantage_of_Lower_Electric_Rates_for_your_Government_Agency.pdf

1. Cooperative Purchasing

"When local governments put aside provincial interests in exchange for the broader benefits to be achieved through Cooperative Purchasing, they can secure the provision and performance of goods and services at a lower cost. Cooperative Purchasing has demonstrated a strong ability to serve as an effective tool to assist local officials save taxpayer dollars. Cooperative Purchasing represents viable alternatives to the conventional "go-it-alone" bidding process. " Many Cooperatives in the state utilize online bidding to secure attractive electricity and natural gas supply service. Utilizing a Cooperative is highly recommended.

Benefits can include:

- Increase staff effectiveness
- Reduce duplication of bidding and contract processing
- Reduce time, effort and costs associated with developing and managing the bid process
- Leverage established and large volume pricing of contracted products
- Great alternative contract option to save time, money and ensure quality products & services

2. Online Reverse Auctions and Online Sealed Bids

"For local government entities, the requirement to bid does not mean the solicitation of quotes; it means a formal process where there is a bid specification, notice to bidders, and a level playing field for all potential bidders. The Division's E-Procurement Pilot program (authorized under P.L. 2001, c. 30) allows local units to purchase commodities and services, including energy supply, through online bidding and reverse auctions programs approved by the Division. Any online organization participating in the online pilot program must be approved by the Division. Once the Division has approved an online service, any local unit can take advantage of the service. When conducted through an online service, however, the local unit is responsible to ensure that the online service is operating consistent with procurement laws for an individual procurement."

Both online reverse auctions and online sealed bids can produce significant cost savings results. The process is transparent and seamless. Many platforms are very flexible allowing for full customization to meet the Client's needs.

All providers of online reverse auction and online bidding charge a fee indirectly to LGE's. The fee is included in the bid pricing shown by suppliers as a \$/kWh or \$/therm charge and paid directly by the supplier to the vendor. Although LGE's do not have to formally bid for this type of service should they utilize a DCA pre-approved vendor, we would recommend that any and all fees paid by the supplier to the vendor be disclosed prior to any engagement of services.

An overview of both the Online Reverse Auction vs Sealed bid format was published in the NJBIZ Spring of 2007. To view this article, please go to web link:

<http://www.nbizmag.com/magarticles/sealedbidvsreverseauction.pdf>

Benefits can include:

- Provides full transparency during the procurement process with unbiased decision making
- Drives prices down through real-time competition
- Allows client to actively participate during the entire auction or online bidding process
- Execution of contracts are completed within hours of the auction's close
- Places the focus for suppliers solely on price, since all other factors and related contracting documentation is received and pre-qualified before the final auction bid due date
- Full audit and archival capabilities to substantiate award decisions
- Improves knowledge capture, transfer and re-use capabilities

3. Traditional Sealed Bid Format

This type of bid format is not endorsed by the Division of Local Government Services for the bidding of power supply. However, in a recent review of bidding methodologies and which methodology would likely to produce lower cost results, a NJ Government Agency allowed suppliers to choose the bidding format. The bidding options allowed were either via an Online Reverse Auction or via a Traditional Sealed Bid. The Agency understood that many suppliers will not participate in an online auction format or methodology and wanted to allow all NJBPU suppliers to participate. The Agency is the 2nd largest Cooperative in the state which includes participants from five Counties and over 200 municipalities. After the online reverse auction bid was closed and the traditional sealed bids opened and reviewed, the Agency awarded the electricity contract to a bidder that was the lowest price and submitted their bid via the Traditional Sealed Bid Format.

The below recommendations presented by Concord Engineering are based on current information provided by the owner for their facilities historical energy usage. Any savings presented with these recommendations are estimates only based on that information. It is recommended that further analysis and review of more recent utility data and actual TPS

electricity and natural gas supply contracts and historical billings be performed prior to performing any of the presented recommendations.

Recommendations:

1. Concord recommends the owner continue its aggregation approach for 3rd party commodity supply procurement strategies for the purchase of electricity and natural gas. Aggregating the usage of all facilities for both electricity and natural gas supply service, allows the owner to continue to achieve lower prices in commodity supply costs over the utility default service programs. Energy commodities are among the most volatile of all commodities, however at this point and time, energy is extremely competitive and contract terms longer than 12 months are desirable. Contracts due to expire in the near term would continue to yield very favorable pricing. It is important to aggregate usage where available and take advantage of these current market prices quickly, before energy increases.
2. After review of the utility consumption report and current commodity pricing outlook, Concord recommends that the owner utilize the advisement of a 3rd party unbiased Energy Consulting Firm licensed by the State of New Jersey Board of Public Utilities that is experienced in the procurement of commodities, New Jersey procurement laws, aggregation of facilities and energy supply risk and commodity management. This firm should be able to provide full service advisement over the term of the contract, provide market watch opportunities and identify any additional opportunities that may further reduce costs. Many of these opportunities may include: energy rates; utility bill auditing; energy data analytics; and efficiency improvements.

It is important that a rational, defensible strategy for purchasing commodity in volatile markets is incorporated. Examples include:

- Budgets that reflect sound market intelligence
 - An understanding of utility and market historical prices and trends
 - Awareness of seasonal opportunities (e.g. shoulder months)
 - Negotiation of fair contractual terms
 - An aggressive, market based price
3. Concord also recommends that the owner consider utilizing a third party utility billing-auditing service to further analyze historical utility invoices such as water, sewer, natural gas, electricity and fuel oil for incorrect billings and rate tariff optimization services. *This service can be based on a shared savings model with no direct cost. The service could provide refunds on potential incorrect billings that may have been passed through by the utilities and paid by the owner.*

PJM Demand Response Programs

Demand response programs may not fit or be applicable to all clients, however if there is an opportunity to shed load, typically above 100 kilowatts, while not having significant impacts on operations and comfort conditions it could warrant consideration. Concord recommends the owner review the program description below from PJM to see if there is a potential fit, as it can become a substantial revenue source dependent on your ability to curtail.

What is PJM?

PJM Interconnection is a regional transmission organization that coordinates the movement of wholesale electricity in all parts of 13 states and the District of Columbia. As an independent party, PJM operates a competitive wholesale electricity market and manages the high-voltage electricity grid to ensure reliability for more than 51 million people. PJM's long-term planning process take a broad, interstate perspective that identifies the most effective and cost efficient improvements to the grid to ensure reliability and economic benefits on the system as a whole.

PJM's "Wholesale" market is focused on entities that buy and sell the electricity, but are not the end consumers of the electricity. The retail market is focused on entities that buy electricity from the wholesale market or produce the electricity, and then sell the electricity to a customer that physically consumes it. PJM does not interact directly with the electricity consumers, but with the companies (or Utility) that provides the electricity to consumers.

What is Demand Response?

Demand Response is a consumer's ability to reduce electricity consumption at their location when wholesale prices are high or the reliability of the electric grid is threatened. Common examples of demand response include: raising the temperature of the thermostat so the air conditioner does not run as frequently, slowing down or stopping production at an industrial operation or dimming/shutting off lights, basically any explicit action taken to reduce load in response to short-term high prices or a signal from PJM.

Demand Response does not include the reduction of electricity consumption based on normal operating practice or behavior. For example, if a company's normal schedule is to close for a holiday, the reduction of electricity due to this closure or scaled-back operation is not considered a demand response activity in most situations.

Retail Customer Program Offerings:

PJM's demand response opportunities enables retail electricity consumers to earn a revenue stream for reducing electricity consumption when either wholesale prices are high or the reliability of the electric grid is threatened. Demand response participation is broken in two broad classifications, Economic and Emergency. An electricity consumer may participate in either or both depending on the circumstances.

Emergency Demand Response primarily represents a mandatory commitment to reduce load or only consume electricity up to a certain level when PJM needs assistance to maintain reliability under supply shortage or expected emergency operation conditions. This is considered a mandatory commitment to which penalties will be applied for non-compliance. The consumer's resources must be available to respond to PJM's request to reduce load where the availability depends on the product selected, as follows:

- *Limited DR* – resource is available for up to 10 weekdays from June through September, where each request may be up to six hours in duration.
- *Extended Summer DR* – resources is available for all days from May through October, where each request may be up to ten hours in duration
- *Annual DR* - resources is available for all days from June through May of following year, where each request may be up to ten hours in duration

PJM considers these resources similar to a generator and fully expects them to perform at the time when the grid most needs it to avoid brownouts and/or rolling blackouts within the PJM service territory. The revenue stream derived from participation is largely driven by the “Capacity” market as defined under the Reliability Pricing Model (RPM). The revenue earned is a function of the relevant RPM price and the load reduction commitment. The resource is paid to be “available” during expected emergency conditions on a monthly basis for a commitment that is made for one year, which starts on June 1 and ends on May 31 of the following year.

Emergency demand response also has the opportunity to participate on a voluntary basis. Under this option, the resources have the option to participate when an emergency is called and will be compensated based on the amount of energy reduced during the emergency. Such resources will not receive revenue from the capacity market.

Economic Demand Response primarily represents a voluntary commitment to reduce load in the energy market when the wholesale price is higher than the published monthly PJM net benefits price. The net benefit price represents the price at which the benefits incurred by a reduction in wholesale prices from the economic demand response will exceed the cost to pay for the economic demand response. The economic demand response will be used to displace a generation resource and PJM expect the resource to perform and will assess deviation charges if the amount of load reductions realized is significantly different than the amount of load reductions dispatched by PJM.

An economic demand response resource may also provide Ancillary Services to the wholesale market with the appropriate infrastructure and qualification by PJM. There are three Ancillary Services markets in which economic demand response resources may participate: Synchronized Reserves (the ability to reduce electricity consumption within 10 minutes of PJM dispatch), Day Ahead Scheduling Reserves (the ability to reduce electricity consumption within 30 minutes of

PJM dispatch) and Regulation (the ability to follow PJM's regulation and frequency response signal). Participation in the market is voluntary; however, if a resource clears, performance is mandatory.

How to Participate?

The first step for a consumer interested in demand response is to contact a Curtailment Service Provider(s) to get a more in-depth understanding of the opportunities and determine whether you have the capability to participate. A list of Curtailment Service Providers is available on PJM's Web site at Markets & Operations > Demand Response > Curtailment Service Providers (www.pjm.com/markets-and-operations/demand-response/csps.aspx). The list includes contact names at the firms; it also indicates in what states the firms do business. PJM also posts on its website the training materials developed for its members who are interested in the rules and requirements for demand response activity at <http://www.pjm.com/training/training-material.aspx>, along with a variety of demand response information at <http://www.pjm.com/markets-and-operations/demand-response.aspx>.

VII. INSTALLATION FUNDING OPTIONS

CEG has reviewed various funding options for the facility owner to utilize in subsidizing the costs for installing the energy conservation measures noted within this report. Below are a few alternative funding methods:

A. Incentive Programs:

Pay For Performance

(www.njcleanenergy.com/commercial-industrial/programs/pay-performance)

The New Jersey Smart Start Pay for Performance Program includes incentives based on savings resulted from implemented ECMs. The program is available for all buildings that were audited as part of the NJ Clean Energy's Local Government Energy Audit Program. The facility's participation in the program is assisted by an approved program partner. An "Energy Reduction Plan" is created with the facility and approved partner to show at least 15% reduction in the building's current energy use. Multiple energy conservation measures implemented together are applicable toward the total savings of at least 15%. No more than 50% of the total energy savings can result from lighting upgrades / changes.

Total incentive is capped at 50% of the project cost. The program savings is broken down into three benchmarks; Energy Reduction Plan, Project Implementation, and Measurement and Verification. Each step provides additional incentives as the energy reduction project continues. The benchmark incentives are as follows:

1. Energy Reduction Plan – Upon completion of an energy reduction plan by an approved program partner, the incentive will grant \$0.10 per square foot between \$5,000 and \$50,000, and not to exceed 50% of the facility's annual energy expense. (Benchmark #1 is not provided in addition to the local government energy audit program incentive.)
2. Project Implementation – Upon installation of the recommended measures along with the "Substantial Completion Construction Report," the incentive will grant savings per KWH or Therm based on the program's rates. Minimum saving must be 15%. (Example \$0.09 / kWh for 15% savings, \$0.10/ kWh for 17% savings, ... and \$0.90 / Therm for 15% savings, \$1.00 / Therm for 17% saving, ...) Increased incentives result from projected savings above 15%.
3. Measurement and Verification – Upon verification 12 months after implementation of all recommended measures, that actual savings have been achieved, based on a completed verification report, the incentive will grant additional savings per kWh or Therm based on the program's rates. Minimum savings must be 15%. (Example \$0.09 / kWh for 15% savings, \$0.10/ kWh for 17% savings, ... and \$0.90 / Therm for 15% savings, \$1.00 / Therm for 17% saving, ...) Increased incentives result from verified savings above 15%.

Based on the provided data within each facility report and the estimated energy savings of each measure, the facilities will not qualify for incentives based on lighting savings accounting for over 50% of the energy savings.

Disclaimer: The Pay for Performance incentives outlined above have been estimated based on the current calculated energy savings for the measures outlined in each facility report. Qualification for the program has been based on meeting the minimum demand threshold of 100 kilowatts and overall project meeting the minimum 15% source energy reduction requirement. This preliminary qualification analysis does not guarantee program incentives or acceptance into the program. The owner will be required to retain a Program Partner and formally apply to the program to determine final project incentives.

Direct Install Program

www.njcleanenergy.com/commercial-industrial/programs/direct-install)

The New Jersey Clean Energy’s Direct Install Program is a state funded program that targets small commercial and industrial facilities with peak demand of less than 200 kW. This turnkey program is aimed at providing owners a seamless, comprehensive process for analysis, equipment replacement and financial incentives to reduce consumption, lower utility costs and improve profitability. The program covers up to 70% of the cost for eligible upgrades including lighting, lighting controls, refrigeration, HVAC, motors, variable speed drives, natural gas and food service. Participating contractors (refer to www.njcleanenergy.com) conduct energy assessments in addition to your standard local government energy audit and install the cost-effective measures.

The following facilities qualify to apply for the Direct Install Program based on current program criteria:

DIRECT INSTALL PROGRAM	
DESCRIPTION	QUALIFY
Valley View School	No
Bayberry School	No
Total	0

Smart Start Program

(www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/nj-smartstart-buildings)

Prescriptive Measures - The New Jersey Clean Energy's Smart Start prescriptive measures incentives include unit pricing incentives for installation of energy efficient equipment and controls. Proposed equipment and controls must meet the minimum efficiency requirements as well as other application requirements. The Smart Start prescriptive incentives applicable for new construction, renovations, remodeling and equipment replacements, for a wide range of equipment including:

- Electric Chillers
- Gas Cooling
- Electric Unitary HVAC
- Ground Source Heat Pumps
- Gas Heating
- Variable Frequency Drives
- Gas Water Heating
- Premium Motors
- Prescriptive Lighting
- Lighting Controls
- Commercial Kitchen Equipment
- Technical Studies

Custom Measures - The New Jersey Clean Energy's Smart Start prescriptive measures incentives include all measures not identified in the prescriptive measures category or measures that must have savings verified through additional analysis such as energy model simulations. Custom measures are intended to include savings as a result of unique energy efficiency measures, which are typically facility specific such as waste heat recovery. Custom incentives are provided based on the amount of energy saved and minimum internal rate of return in order to be eligible.

The owner should refer to the Clean Energy Program website for further details on specific incentives available. (www.njcleanenergy.com)

Concord Engineering recommends the Owner review the use of the above-listed funding options in addition to utilizing their standard method of financing for facilities upgrades in order to fund the proposed energy conservation measures.

B. Financing Options:

The following section outlines various funding mechanisms available to fund energy efficiency projects. It is the local government unit's responsibility to verify these funding sources adhere to all required federal, state, and local finance laws.

Municipal Bonds

Municipal bonds are a bond issued by a city or other local government, or their agencies. Potential issuers of municipal bonds include cities, counties, redevelopment agencies, school districts, publicly owned airports and seaports, and any other governmental entity (or group of governments) below the state level. Municipal bonds may be general obligations of the issuer or secured by specified revenues. Interest income received by holders of municipal bonds is often exempt from the federal income tax and from the income tax of the state in which they are issued, although municipal bonds issued for certain purposes may not be tax exempt.

Municipal Lease Purchase (Long-term Municipal Lease Agreements)

A Municipal Lease is a contract that has many of the characteristics of a standard commercial lease, with three primary differences. In a Municipal Lease, the intent of the lessee is to purchase and take title to the equipment. The financing is a full payout contract with no significant residual or balloon payments at the end of the lease term. The lease payments include the return of principal and interest, with the interest being exempt from Federal income taxation to the recipient. Typically, a tax-exempt interest transaction will be financed at interest rates lower than equivalent commercial financing. The Municipal Lease provides for termination for non-appropriation of funds by the Government Agency. A Municipal Lease offers several advantages over alternative methods of financing such as simplicity, speed of delivery, non-appropriation, buyout terms, and cost. Under most state statutes, municipal contracts with terms of over one year require significant investments in time and money in order to comply with municipal debt restrictions. Since a Municipal Lease is, in effect, a year-to-year obligation, many of these requirements do not apply. The ease of executing a Municipal Lease minimizes the elapsed time and the expenses associated with issuing any kind of certificate of indebtedness or bond.

Lease to Own (Leaseback)

A lease to own arrangement is where the seller of an asset (i.e. building, equipment, etc.) leases back the same asset from the purchaser. In a leaseback arrangement, the specifics of the arrangement are made immediately after the sale of the asset, with the amount of the payments and the time period specified. Essentially, the seller of the asset becomes the lessee and the purchaser becomes the lessor in this arrangement. A leaseback arrangement is useful when entities need to un-tie the cash invested in an asset for other investments, but the asset is still needed in order to operate. Leaseback deals can also provide the seller with additional tax deductions. The lessor benefits in that they will receive stable payments for a specified period of time.

Power Purchase Agreement

Public Law 2008, Chapter 3 authorizes contracts of up to fifteen (15) years for energy purchase contracts commonly known as “power purchase agreements.” These are programs where the contracting unit (Owner) procures a contract for, in most cases, a third party to install, maintain, and own a renewable energy system. These renewable energy systems are typically solar panels, windmills or other systems that create renewable energy. In exchange for the third party’s work of installing, maintaining and owning the renewable energy system, the contracting unit (Owner) agrees to purchase the power generated by the renewable energy system from the third party at agreed upon energy rates.

On-Bill Financing

On-bill financing allows a loan for energy efficiency measures to be repaid over time via an additional line item on the recipient’s utility bill, which decreases repayment risk for the lender. The lender in “classic” utility on-bill financing has traditionally been the utility itself. Hybrid models have also emerged in which public and private funds are pooled to offer low-interest loans, with repayment similarly attached to the utility bill. The utility then collects the payment and returns it to the lender, which lowers the lender’s administrative costs. The utility customer benefits from lower energy costs after retrofits, and typically pays loans back over a period of about 2–5 years. This model has also recently become available with Third Party Commodity Suppliers allowing for energy efficiency project funding to be rolled into their bill for the customer. If the owner is interested in this funding mechanism they should contact their local utility or third party supplier if any such program is offered. Alternatively if the owner’s current third party supply contract is expiring this could be included as an option when bidding for new suppliers.

Public-Private Partnerships

A public-private partnership is a business relationship between a public entity and a private-sector company for the purpose of completing a project that will serve the public. These types of partnerships can be used to finance, build, and operate various types of projects such as public transportation networks, new buildings, parks, and convention centers. In lieu the traditional path of a public entity funding the project, a private enterprise would fund it in exchange for receiving some type of financial benefit from the project once complete.

Energy Savings Improvement Program (ESIP):

Public Law 2009, Chapter 4 authorizes government entities to make energy related improvements to their facilities and pay for the costs using the value of energy savings that result from the improvements. The “Energy Savings Improvement Program (ESIP)” law provides a flexible approach that can allow all government agencies in New Jersey to improve and reduce energy usage with minimal expenditure of new financial resources. This program provides public entities to make valuable facility infrastructure improvements that are associated with energy savings. All energy savings projects are eligible as long as the financing period does not extend beyond 15 years. The financing can be utilized for all aspects of energy efficiency project

implementation including, energy savings plan development, engineering, construction management, construction management, commissioning, and measurement and verification.

This program provides the much needed financing for energy efficiency projects without the burden of increased debt. The program allows for procurement of financing without voter approval or extending existing debt. The program requires evaluation to ensure a positive cash-flow through the entire 15 year financing period. The first phase of implementing an ESIP is the development of an Energy Savings Plan (ESP) to verify the energy savings, construction costs, and overall financial model.

VIII. ENERGY AUDIT ASSUMPTIONS

The assumptions utilized in this energy audit include but are not limited to following:

- A. Cost Estimates noted within this report are based on industry accepted costing data such as RS MeansTM Cost Data, contractor pricing and engineering estimates. All cost estimates for this level of auditing are +/- 20%. Prevailing wage rates for the specified region has been utilized to calculate installation costs. The cost estimates indicated within this audit should be utilized by the Owner for prioritizing further project development post the energy audit. Project development would include investment grade auditing and detailed engineering.
- B. Energy savings noted within this audit are calculated utilizing industry standard procedures and accepted engineering assumptions. For this level of auditing, energy savings are not guaranteed.
- C. Information gathering for each facility is strongly based on interviews with operations personnel. Information dependent on verbal feedback is used for calculation assumptions including but not limited to the Operating Hours, Equipment Type, Control Strategies, and Scheduling.
- D. Information contained within the major equipment list is based on the existing Owner documentation where available (drawings, O&M manuals, etc.). If existing Owner documentation is not available, catalog information is utilized to populate the required information.
- E. Equipment incentives and energy credits are based on current pricing and status of rebate programs. Rebate availability is dependent on the individual program funding and applicability. It is the Owner's responsibility to ensure installed measure equipment meets NJOCE program rules and requirements to receive these incentives.
- F. Equipment (HVAC, Plumbing, Electrical, & Lighting) noted within an ECM recommendation is strictly noted as a **basis for calculation** of energy savings. The Owner should use this equipment information as a benchmark when pursuing further investment grade project development and detailed engineering for specific energy conservation measures.
- G. Utility bill annual averages are utilized for calculation of all energy costs unless otherwise noted. Accuracy of the utility energy usage and costs are based on the information provided by the Owner. Utility information including usage and costs is estimated where incomplete data is provided.
- H. Greenhouse Gas Emissions are calculated for each ECM, the basis for these emissions reductions are NJCEP published standard emissions factors, which are the following:
 - a. Electric Savings:
 1. CO₂: 1.52 lbs/kWh
 2. NO_x: 0.0028 lbs/kWh
 3. SO₂: 0.0065 lbs/kWh
 - b. Natural Gas Savings:
 1. CO₂: 11.7 lbs/therm
 2. NO_x: 0.0092 lbs/therm